


Apex & Apexe System Sizing Chart

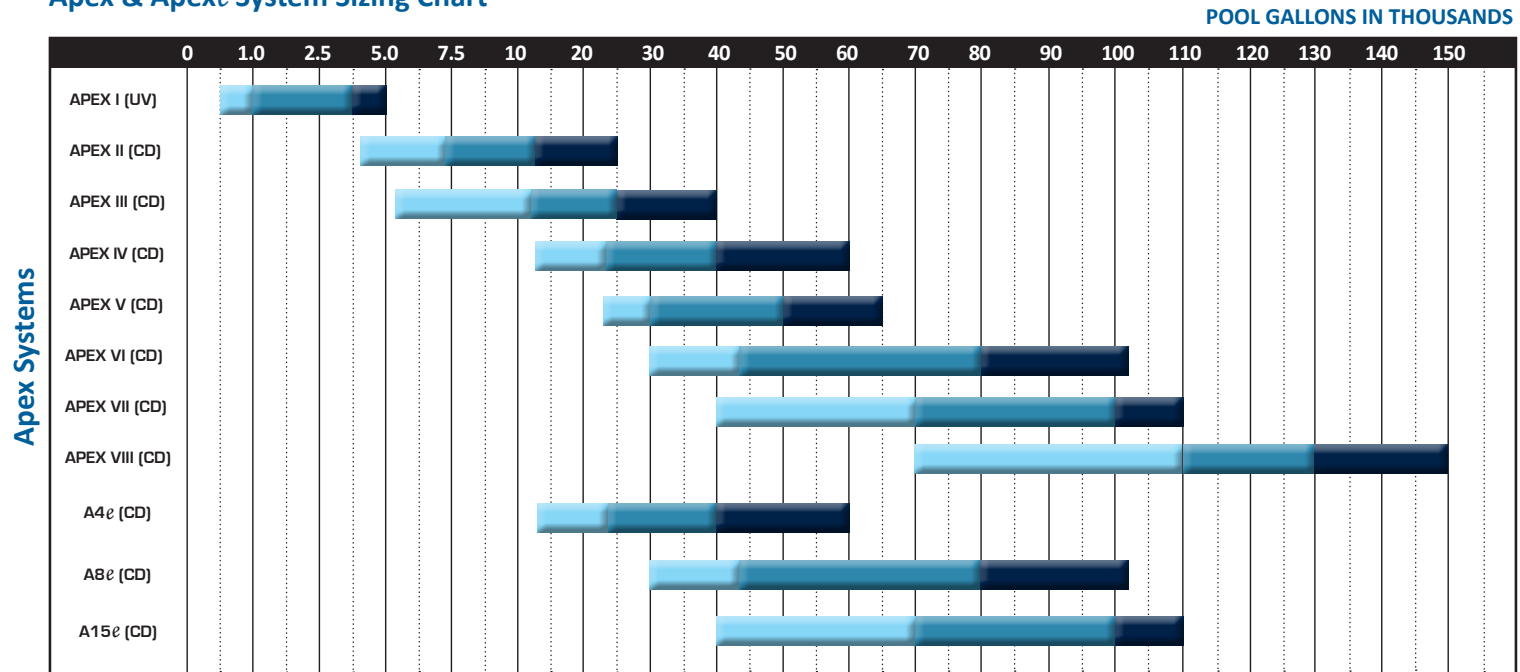

NOTE: Certified by the Water Quality Association under the Gold Seal Program to NSF/ANSI Swimming Pool Standard 50. Results based on 79° F water temperature, will vary based on location and usage.

ULTRA-LOW CHLORINE
 < 0.50 ppm chlorine

LOW CHLORINE
 0.50 - 0.80 ppm chlorine

TYPICAL CHLORINE
 0.80 - 1.50 ppm chlorine